


Decorative, Quadro, Wall Mount CFL

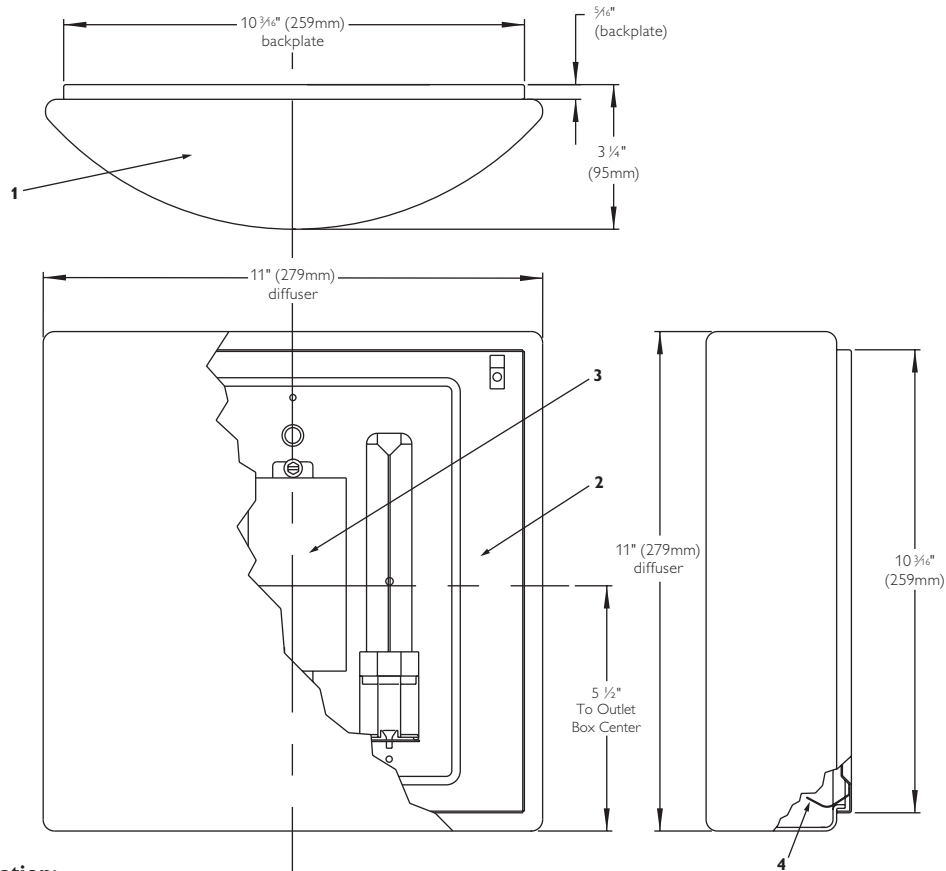


Ordering Information:

Catalog No.	Finish	Lamps	Width	Height	Extension	Ballast	Line Voltage	Line Current, Amps	Input Watts
40600N1	white	(2) 13W	11"	11"	3 1/4"	2 -1 Lt. NPF, Magnetic	120V	.60	35
40600H1		Twin Tube				2 -1 Lt. HPF, Magnetic	120V	.28	31
40600N2		Compact Fluorescent				1 -2 Lt. NPF, Magnetic	277V	.56	35
40600H1									

Job Information	Type:
Job Name:	
Cat. No.:	
Notes:	

Decorative, Quadro, Wall Mount CFL

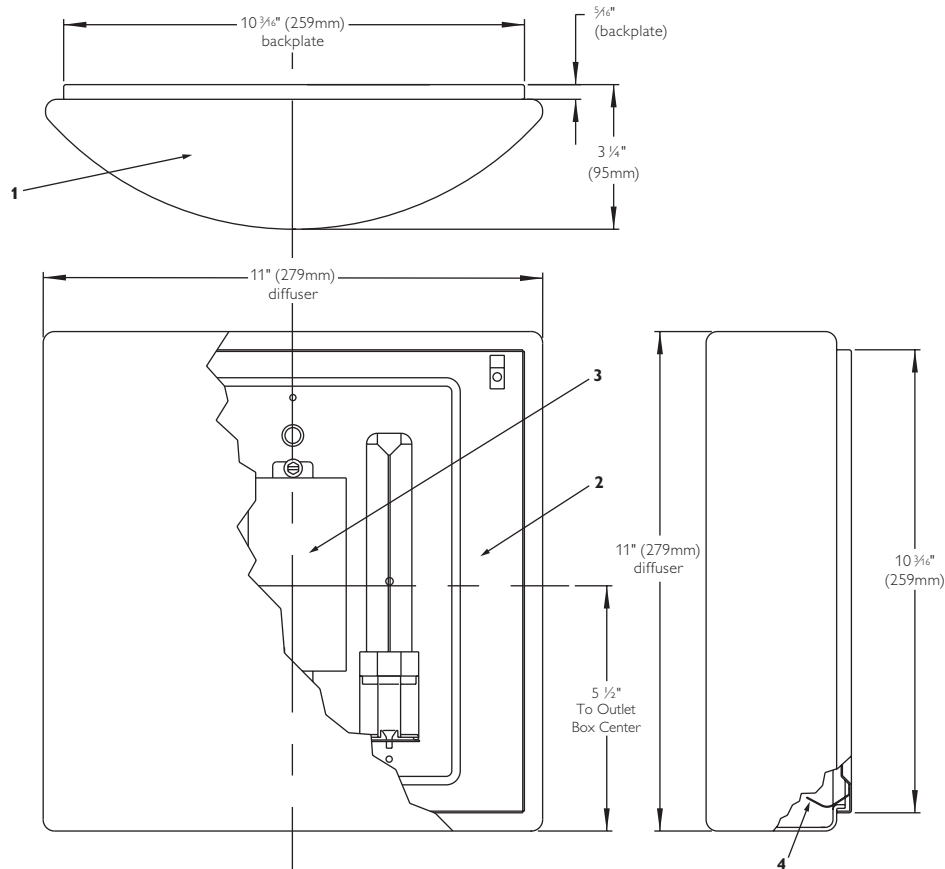

Features

1. **Diffuser:** One piece translucent white acrylic. Removable by pulling diffuser away from (4) spring clips.
2. **Backplate:** Die formed 20 ga. steel. Semi-gloss white finish.
3. **Ballast(s):** See chart on pg. 1 for voltage and power factor options. All ballasts are thermally protected Class "P". Minimum starting temperature 32° F.
4. **Diffuser Clips:** (4) .02 thick spring steel, zinc plated.

Electrical

Fixtures are rated for connections to 60°C building wire, therefore, they can be used for either old or new construction.

Mounting

Fixtures are provided with a mounting plate suitable for direct mounting to most outlet boxes.

Finish

All painted surfaces, baked enamel.

Labels

UL (Suitable for damp locations), I.B.E.W.


Job Information	Type:
------------------------	--------------

PHILIPS

LIGHTOLIER

Decorative, Quadro, Wall Mount CFL

Decorative Quadro Wall Fixture, 11 X 11 X 3 1/4", 2-13W Twin Tube Compact Fluorescent Lamps,
Lumen Rating = 900 Lumens, Osram Dulux S F13TT/27K

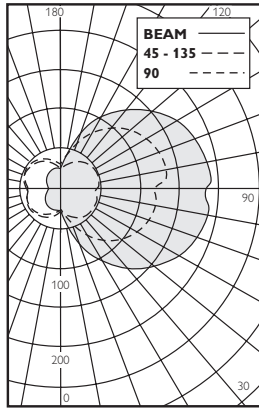

Luminance Summary - CD. / Sq. M.

Angle	Along	45	Across
45	835	1733	2558
55	1067	2398	3601
65	1453	3509	5364
75	2306	5952	9238
85	6438	17409	27413

Certified Test Report
No: 2646FR
Computed by LSI Program
TEST-LITE
Date: August 13, 1993
Prepared for
Lightolier, Secaucus, NJ

Candlepower summary

Angle	Along	22.5	45	67.5	Across	Lumens
0	29	29	29	29	29	
5	30	31	32	34	34	2
15	34	39	47	56	59	7
25	39	48	64	81	89	15
35	43	57	81	105	116	25
45	46	64	95	126	141	37
55	48	69	107	144	161	47
65	48	72	115	157	176	57
75	47	73	120	166	186	63
85	44	70	118	165	186	64
90	44	71	118	164	185	
95	47	87	133	174	190	68
105	48	86	131	170	185	66
115	49	84	126	162	176	60
125	48	78	115	147	160	50
135	46	71	102	129	140	38
145	42	61	85	107	115	26
155	37	50	66	81	87	15
165	32	39	47	55	58	7
175	28	29	31	32	32	1
180	27	27	27	27	27	

Zonal Lumens and Percentages

Zone	Lumens	%Lamp	%Luminaire
0-30	35	2.00	4.44
0-40	70	3.94	8.74
0-60	179	9.95	22.11
0-90	399	22.22	49.35
40-90	329	18.28	40.61
60-90	220	12.27	27.24
90-180	410	22.80	50.65
0-180	810	45.02	100.00

Efficiency = 45.0%

Corridor Lighting
Footcandles on Floor

Height	1'	2'	3'	4'	5'	6'	7'
10'	0.6	0.7	0.7	0.7	0.7	0.7	0.7
9'	0.7	0.8	0.8	0.8	0.8	0.8	0.8
8'	0.9	0.9	0.9	0.9	1.0	0.9	0.9
7'	1.0	1.1	1.1	1.1	1.1	1.1	1.0
6'	1.2	1.3	1.3	1.3	1.3	1.3	1.2
5'	1.4	1.5	1.6	1.6	1.6	1.5	1.4
4'	1.6	1.8	1.9	1.9	1.8	1.7	1.6
3'	1.8	2.0	2.1	2.2	2.1	2.0	1.8
2'	2.0	2.3	2.4	2.5	2.3	2.2	2.0
1'	2.1	2.5	2.7	2.7	2.5	2.3	2.1
0'	2.1	2.5	2.8	2.7	2.6	2.4	2.1

Luminaire

Footcandle values are initial.
Luminaire mounted 6'6" above floor.
Corridor is 8" wide by 8" high.
Room Reflectances:
80% Ceiling, 50% Walls, 20% Floor.
For multiple luminaires add together footcandle values contributed by each luminaire at point(s) desired.

Tested according to IES procedures.
Test distance exceeds five times the greatest luminous opening of luminaire.



Philips Lightolier
e: lol.webmaster@philips.com
t: (508) 679-8131
w: www.lightolier.com
40600 May 25, 2011

Job Information Type:

Specifications are subject to change without notice.
© Koninklijke Philips Electronics N.V., 2011. All rights reserved.